


SPECIFICATIONS	
P/N	VA5137-2
MODEL	CAMERA PSU, NEMA 1 / IP20, 120V AC IN, 12V DC OUT
INPUT SPECIFICATIONS	120V AC, 50/60 Hz, .45A
OUTPUT SPECIFICATIONS	12 VDC, 1A MAX.
FEATURES	
- NEMA TYPE 1 / IP20 ENCLOSURE. CUSTOMER MUST LOCATE IN A SUITABLE AREA OR ENCLOSURE AS NEEDED.	
- MAX. RECOMMENDED DISTANCE BETWEEN PSU AND CAMERA IS 500 FT. [122 m] WITH 16 AWG / 1.5mm ² SHIELDED WIRE.	

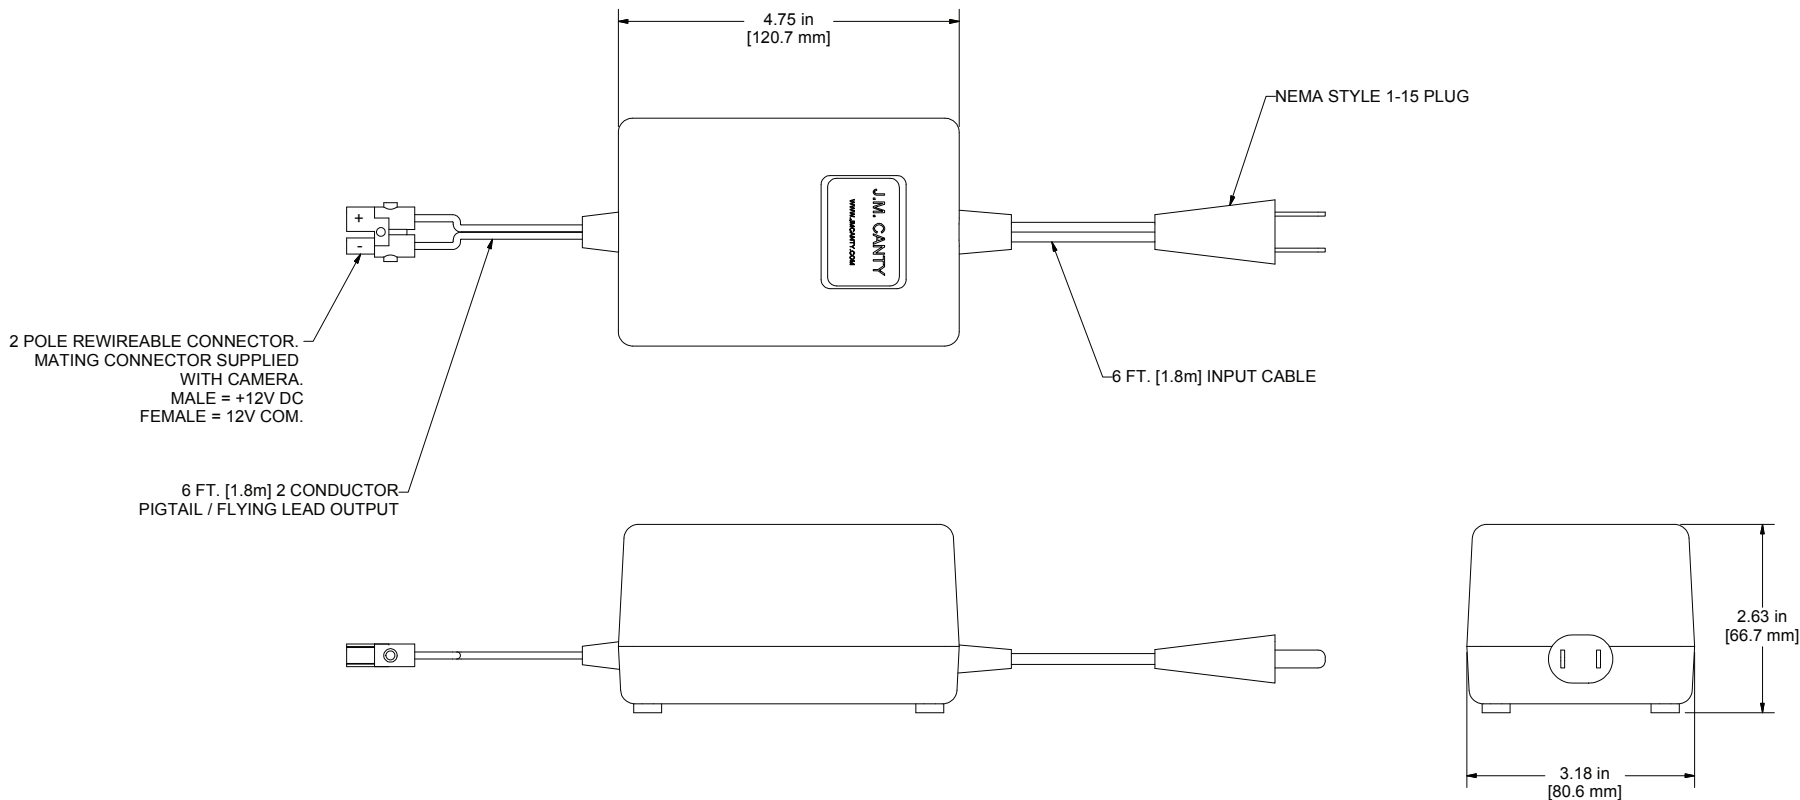

NOTES:
1. ALL INFORMATION IS SUBJECT TO CHANGE WITHOUT NOTICE.

NOTICE THIS DRAWING IS THE PROPERTY OF J.M. CANTY AND MUST BE RETURNED WITHOUT REPRODUCTION OR DUPLICATION, AT ANY TIME UPON REQUEST, BUT IN ANY EVENT AS SOON AS IT HAS SERVED THE PURPOSE FOR WHICH IT WAS FURNISHED. WHILE IN THE POSSESSION OF THE RECIPIENT, IT MUST BE PROPERLY SAFEGUARDED AGAINST DISCLOSURE TO ANYONE EXCEPT THOSE EMPLOYEES WHO REQUIRE IT FOR WORK OR JOB. THE RECIPIENT MUST KEEP CONFIDENTIAL AND REQUIRE HIS (HER) EMPLOYEES TO KEEP CONFIDENTIAL THE INFORMATION CONTAINED HERE ON.		IMPORTANT FOR THE REQUIRED MANUFACTURING SPECIFICATIONS SEE DOCUMENT #A4955 NOTE: FAILURE TO RECEIVE DOCUMENT DOES NOT WAIVE VENDOR RESPONSIBILITY		DRAWN BY JD	DATE 08/24/07	J.M. CANTY INC. 6100 DONNER RD. BUFFALO, N.Y. 14094 U.S.A.	CANTY WWW.JMCANTY.COM	J.M. CANTY INTL. LTD. BALLYCOOLIN BUS. PK. BLANCHARDSTOWN DUBLIN 15, IRELAND
		APPROVAL JD	DATE 08/27/07					
		ENGINEERING ANALYSIS CURRENT	DATE	TITLE CAMERA POWER SUPPLY SPEC., P/N VA5137-2, NEMA 1 / IP20, 120V AC IN, 12V DC OUT				
		MFG. APPROVAL PENDING	DATE	SIZE REVISION C 0	FILE NAME C10878			
		QUALITY CONTROL I.O.A.	DATE	SCALE AS NOTED	SHEET 1 OF 1			