
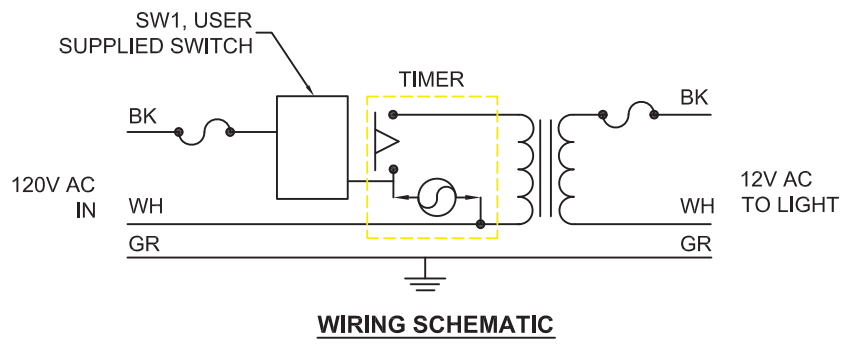
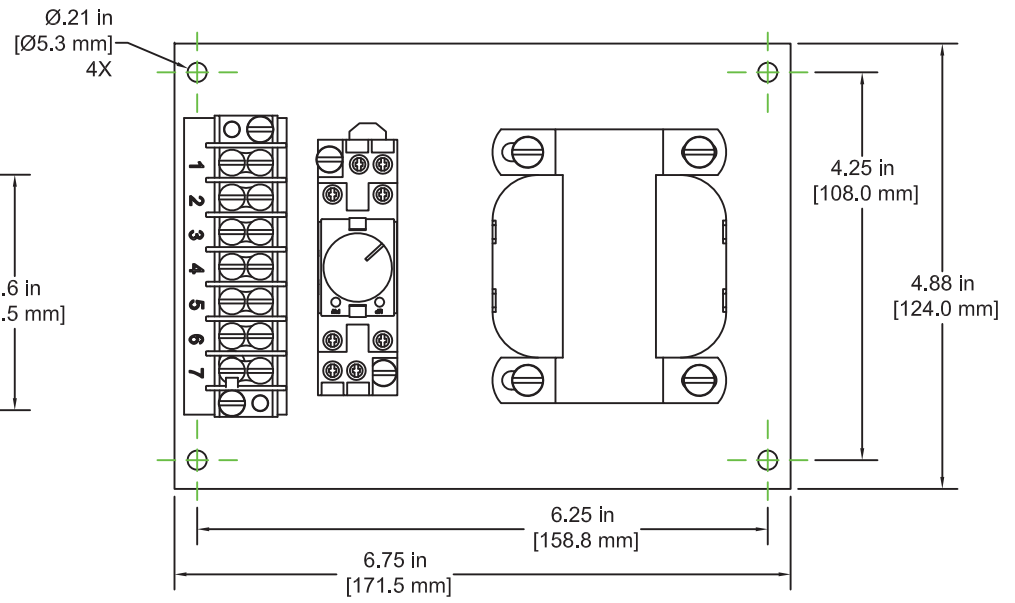


TERMINAL BLOCK	
POSITION	FUNCTION
1	120V AC (HOT) INPUT
2	120V AC (COM) INPUT
3	GROUND INPUT
4	NO CONNECTION
5	AC (HOT) OUTPUT
6	AC (COM) OUTPUT
7	GROUND OUTPUT

SPECIFICATIONS	
P/N	LC39801-1
MODEL	HYL 50-BM (120V)
INPUT VOLTAGE	120V AC, 50/60 Hz
OUTPUT VOLTAGE	12V AC
POWER REQUIREMENT	50 VA
TIMER	30 SEC. TO 10 HRS.

- FEATURES**
- METAL BASE MOUNT POWER SUPPLY, NEMA UNRATED / IP00
 - CUSTOMER SUPPLIES ENCLOSURE AND SWITCH
 - FULLY ADJUSTABLE SHUTOFF TIMER INCLUDED

NOTES:
1. ALL INFORMATION SUBJECT TO CHANGE WITHOUT NOTICE

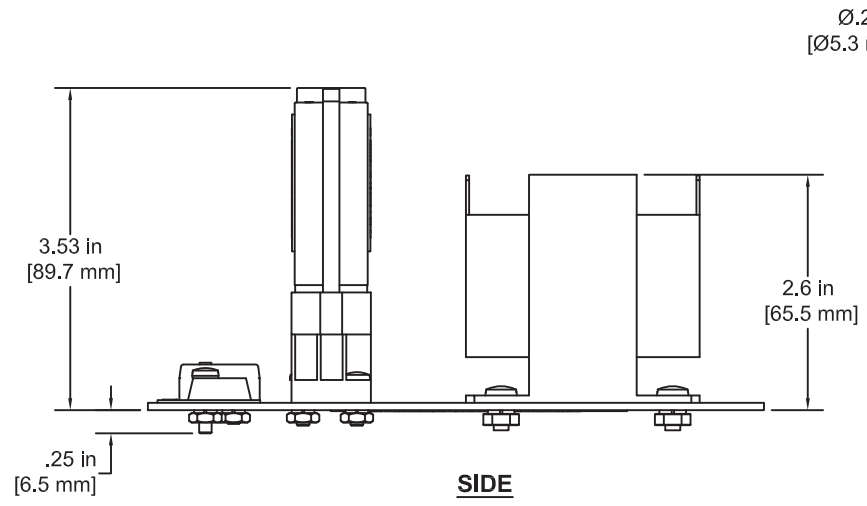

<p>NOTICE THIS DRAWING IS THE PROPERTY OF J.M. CANTY AND MUST BE RETURNED WITHOUT REPRODUCTION OR DUPLICATION, AT ANY TIME UPON REQUEST, BUT IN ANY EVENT AS SOON AS IT HAS SERVED THE PURPOSE FOR WHICH IT WAS FURNISHED, WHILE IN THE POSSESSION OF THE RECIPIENT, IT MUST BE PROPERLY SAFEGUARDED AGAINST DISCLOSURE TO ANYONE EXCEPT THOSE EMPLOYEES WHO REQUIRE IT FOR WORK OR JOB. THE RECIPIENT MUST KEEP CONFIDENTIAL AND REQUIRE HIS (HER) EMPLOYEES TO KEEP CONFIDENTIAL THE INFORMATION CONTAINED HERE ON.</p>	<p>DRAWN BY GKW</p>	<p>DATE 19-OCT-07</p>	<p>J.M. CANTY INC. 6100 DONNER RD. BUFFALO, N.Y. 14094 U.S.A.</p>	<p>CANTY WWW.JMCANTY.COM</p>	<p>J.M. CANTY INTL. LTD. BALLYCOOLIN BUS, PK. BLANCHARDSTOWN DUBLIN 15, IRELAND</p>
	<p>APPROVAL JD</p>	<p>DATE 09-NOV-07</p>	<p>TITLE POWER SUPPLY SPECIFICATIONS, P/N LC39801-1, MODEL HYL 50-BM (120V)</p>		
	<p>ENGINEERING ANALYSIS CURRENT</p>	<p>DATE</p>	<p>SIZE REVISION C 0</p>	<p>FILE NAME C10939</p>	
	<p>MFG. APPROVAL PENDING</p>	<p>DATE</p>	<p>SCALE N.T.S.</p>	<p>SHEET 1 OF 1</p>	