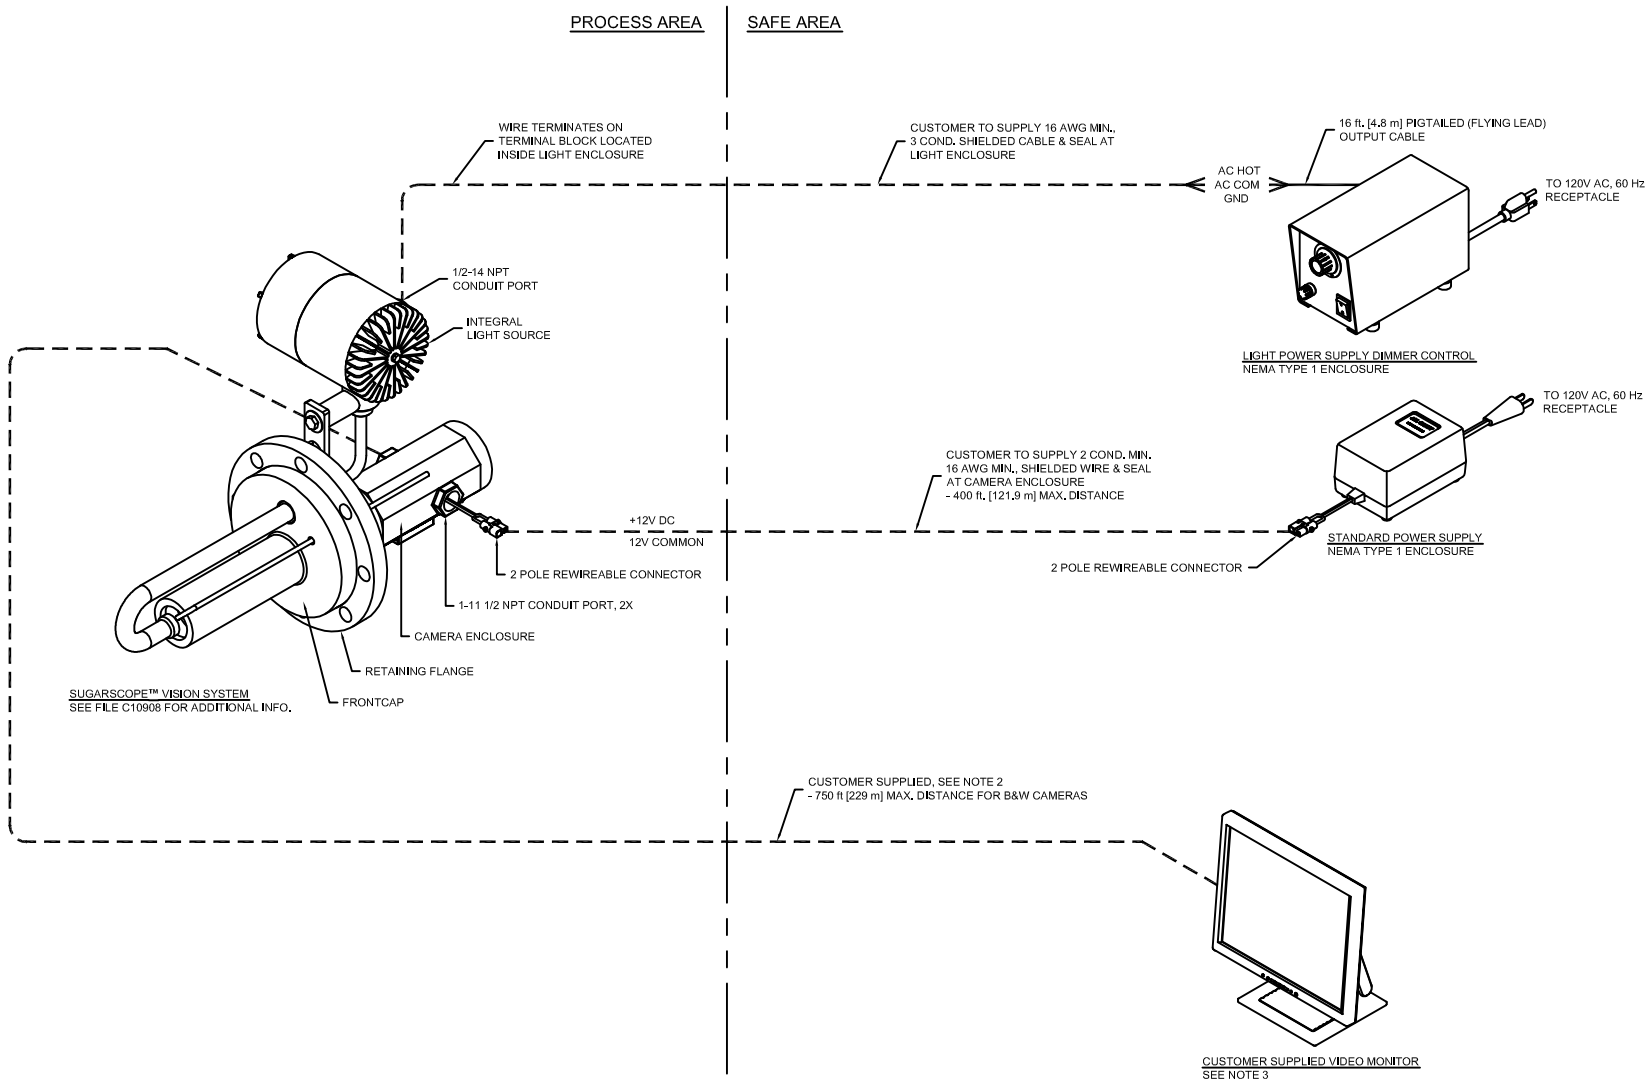

NOTES:

1. ALL WIRING AND CONNECTORS ARE SUPPLIED BY CUSTOMER AND MUST BE COMPLETED IN ACCORDANCE WITH APPLICABLE REGULATIONS.
2. CUSTOMER MUST SUPPLY RG-59/U, RG-11/U OR RG-6/U, 75Ω COAXIAL CABLE SUITABLE FOR CCTV APPLICATIONS. DO NOT SUBSTITUTE CATV OR MATV CABLE. WHERE NOTED, CUSTOMER TO SPECIFY CABLE AND TERMINATIONS TO MEET PROJECT REQUIREMENTS AND CABLE DISTANCE RUNS.
3. VIDEO MONITOR SHALL ACCEPT AN NTSC OR EIA ANALOG CAMERA INPUT. MONITOR MUST INCLUDE A COMPOSITE VIDEO INPUT CONNECTION AND 75Ω / HIGH INPUT IMPEDANCE (SWITCHABLE).
4. ALL INFORMATION SUBJECT TO CHANGE WITHOUT NOTICE.

NOTICE
THIS DRAWING IS THE PROPERTY OF J.M. CANTY AND MUST BE RETURNED WITHOUT REPRODUCTION OR DUPLICATION, AT ANY TIME UPON REQUEST, BUT IN ANY EVENT AS SOON AS IT HAS SERVED THE PURPOSE FOR WHICH IT WAS FURNISHED. WHILE IN THE POSSESSION OF THE RECIPIENT, IT MUST BE PROPERLY SAFEGUARDED AGAINST DISCLOSURE TO ANYONE EXCEPT THOSE EMPLOYEES WHO REQUIRE IT FOR WORK OR JOB. THE RECIPIENT MUST KEEP CONFIDENTIAL AND REQUIRE HIS (HER) EMPLOYEES TO KEEP CONFIDENTIAL THE INFORMATION CONTAINED HERE ON.

IMPORTANT
FOR THE REQUIRED MANUFACTURING SPECIFICATIONS SEE DOCUMENT #A4955

NOTE: FAILURE TO RECEIVE DOCUMENT DOES NOT WAIVE VENDOR RESPONSIBILITY

DRAWN BY	GKW	DATE	14-MAY-10
APPROVAL	JD	DATE	17-MAY-10
ENGINEERING ANALYSIS	CURRENT	DATE	
MFG. APPROVAL	PENDING	DATE	
QUALITY CONTROL	I.O.A.	DATE	

J.M. CANTY INC.
6100 DONNER RD.
BUFFALO, N.Y. 14094
U.S.A.

CANTY
WWW.JMCANTY.COM

J.M. CANTY INTL. LTD.
BALLYCOOLIN BUS. PK.
BLANCHARDSTOWN
DUBLIN 15, IRELAND

TITLE
VISION SYSTEM LAYOUT, SUGARSCOPE™, 6" 150 lb. ANSI FLANGE MOUNT W/ INSERTION, ANALOG VIDEO OUTPUT

SIZE	REVISION	FILE NAME
D	0	D11377

SCALE NTS

SHEET 1 OF 1